

Product Specification

Product name: Molded Case Circuit Breaker (MCCB)

Product model: NDM2-800

Date: 20111122

Prepared by	Reviewed by	Approved by
Xu Saijin	Ju Jihong	Shao Yanqi

Nader 良信电器	Document name	Product Specification	Document No.	NDT500221
	Product model and name	NDM2-800 Molded Case Circuit Breaker	Version	2
			Implementation date	20160701

Revision History

Version	Revision Content	Revision Date	Revised by
1	10. The number of plain washers in the accessory list is changed to 8/set from 4/set.	20120718	Xu Saijin
2	Appearance version upgrade	20160610	Peng Haoran

Document No.	NDT500221	Version	1	Implementation date	20160630
--------------	-----------	---------	---	---------------------	----------


1. Applicable Scope and Purpose

NDM2 series of molded case products apply to infrequent switching of circuits with the AC 50Hz (or 60Hz), the rated working voltage of 690V and rated working current of 800A as well as infrequent motor starting. With the overload, short circuit and undervoltage protection functions, the circuit breaker can protect lines and power equipment from damage.

2. Picture of the Product



3. Specification and Model Description

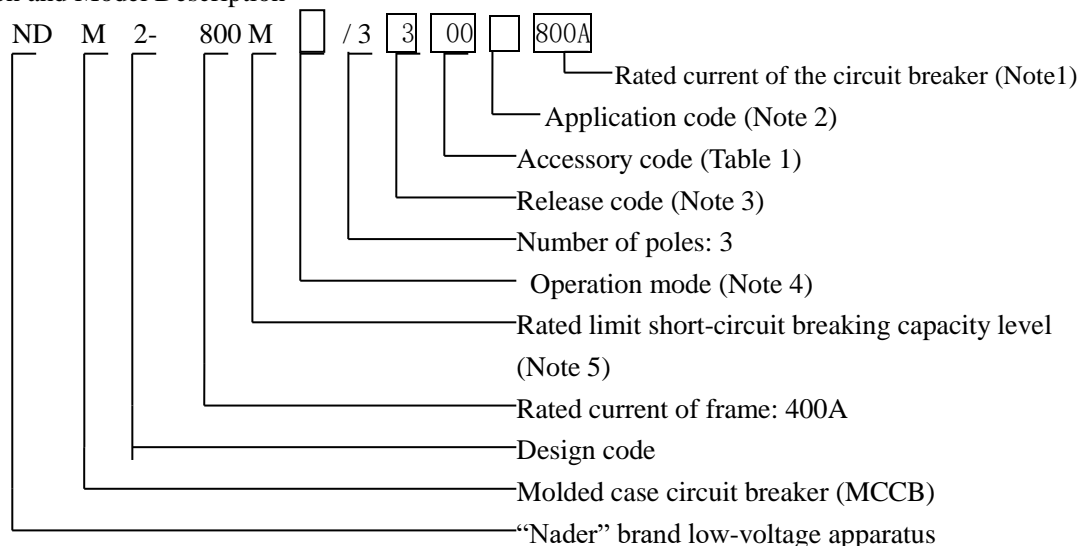

Document No.	NDT500221	Version	1	Implementation date	20160630
--------------	-----------	---------	---	---------------------	----------

Note 1: The rated current is: 630A, 700A, 800A,.

Note 2: Application code: No code is available for the circuit breaker for distribution; the protection motor type is represented as 2.

Note 3: Release code

0: Tripper (none)

2: Instantaneous tripper only

3: Complex tripper

Note 4 Operation mode:

No code is available for the direct handle-operated mode

P: Motor-operated

Z: Rotation handle


Note 5: Rated limit short-circuit breaking capacity level:

M: Relatively high breaking type





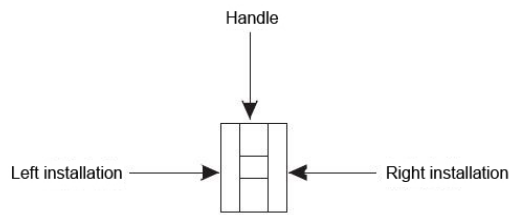

H: High breaking type

















































































































































































































































Document No.	NDT500221	Version	1	Implementation date	20160630
--------------	-----------	---------	---	---------------------	----------

Table 1: Comparison Table of Accessory Code:



Legend :

-  Single auxiliary contact
-  Dual-auxiliary contact
-  Alarm contact
-  Shunt release
-  Under-voltage release
-  (Single auxiliary & alarm) contact

Accessory code	Accessory name	Installation position		Model		NDM2-250		NDM2-400		NDM2-630		NDM2-800	
		Left	Right	Number of poles		3	4	3	4	3	4	3	4
				3	4	3	4	3	4	3	4		
00	None	—	—	—	—	—	—	—	—	—	—	—	—
10	Shunt release												
20	Dual-auxiliary contact												
21	Single auxiliary contact												
30	Under-voltage release												
40	Shunt release, dual-auxiliary contact												
41	Shunt release, single auxiliary contact												
50	Shunt release, under-voltage release												
60	Two sets of dual auxiliary contacts												
61	Two sets of single auxiliary contacts												
62	Dual-auxiliary contact, single auxiliary contact												
70	Under-voltage release, dual-auxiliary contact												
71	Under-voltage release, single auxiliary contact												
08	Alarm contact												
18	Shunt release, alarm contact												
28	Dual-auxiliary contact, alarm contact												
38	Under-voltage release, alarm contact												
48	Shunt release, single auxiliary/alarm contact												
58	Single auxiliary/alarm contact												
68	Dual-auxiliary contact, single auxiliary/alarm contact												
78	Under-voltage release, single auxiliary/alarm contact												

Document No.	NDT500221	Version	1	Implementation date	20160630
--------------	-----------	---------	---	---------------------	----------

4. Main Technical Parameters

(1). Electrical characteristics

- ▲ Rated insulation voltage U_i : 1000V
- ▲ Rated working voltage U_e : AC 415V or AC 690V (only for Type M)
- ▲ Rated current of frame I_{nm} : 800A
- ▲ Rated limit short-circuit breaking current I_{cu} :
Type M: 75KA (AC 415V)
20KA (AC 690V)
Type H: 100KA
- ▲ Rated operating short-circuit breaking current I_{cs} :
Type M: 56KA (AC 415V)
15KA (AC 690V)
Type H: 75KA
- ▲ Rated working current of the auxiliary contact: 0.4A
- ▲ The conventional thermal current of the auxiliary contact: 3A

(2). Operating performance

- ▲ With electricity: 7,500 times
- ▲ Without electricity: 10,000 times

(3). Connection capacity:

Rated Current (A)	Cables		Copper Bars	
	Quantity	Sectional Area (mm ²)	Quantity	Dimension (mm ²)
630	2	185	2	40×5
700	2	240	2	50×5
800	2	240	2	50×5

4) Tightening torque value of terminal/mounting screw

Rated current of frame	Thread diameter	Torque value (N·m)
NDM2-800	M12	28
	M6	6

5 High-altitude derating factor

Altitude (km)	Rated operating current	Maximum operating voltage	Rated power frequency withstand voltage
2	I_n	U_e	U
2.5	I_n	U_e	U
3	$0.980I_n$	$0.87U_e$	$0.909U$
3.5	$0.972I_n$	$0.846U_e$	$0.858U$
4	$0.963I_n$	$0.813U_e$	$0.820U$
4.5	$0.951I_n$	$0.781U_e$	$0.784U$
5	$0.938I_n$	$0.743U_e$	$0.752U$

5. Normal Working Environment


Normal Working Environment

Document No.	NDT500221	Version	1	Implementation date	20160630
--------------	-----------	---------	---	---------------------	----------

- ▲ Altitude: $\leq 2000\text{m}$.
- ▲ Ambient temperature: $-35^{\circ}\text{C} \sim +70^{\circ}\text{C}$.
- ▲ Pollution level: 3.
- ▲ The product can withstand the effects of wet air, salt mist and oil mist.
- ▲ The maximum gradient is 22.5° .
- ▲ The product can be disposed in places that are free from explosive media, media corrosive to metal, insulation damaging gas, and conductive dust.


The product should be installed free from snow and rain.

6. Tripping Characteristics

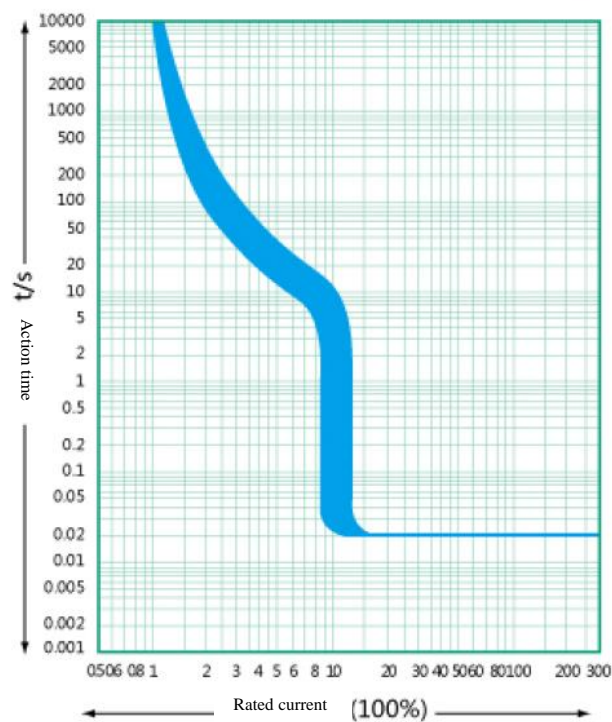

Document No.	NDT500221	Version	1	Implementation date	20160630
--------------	-----------	---------	---	---------------------	----------

7. Outline and Installation Dimensions

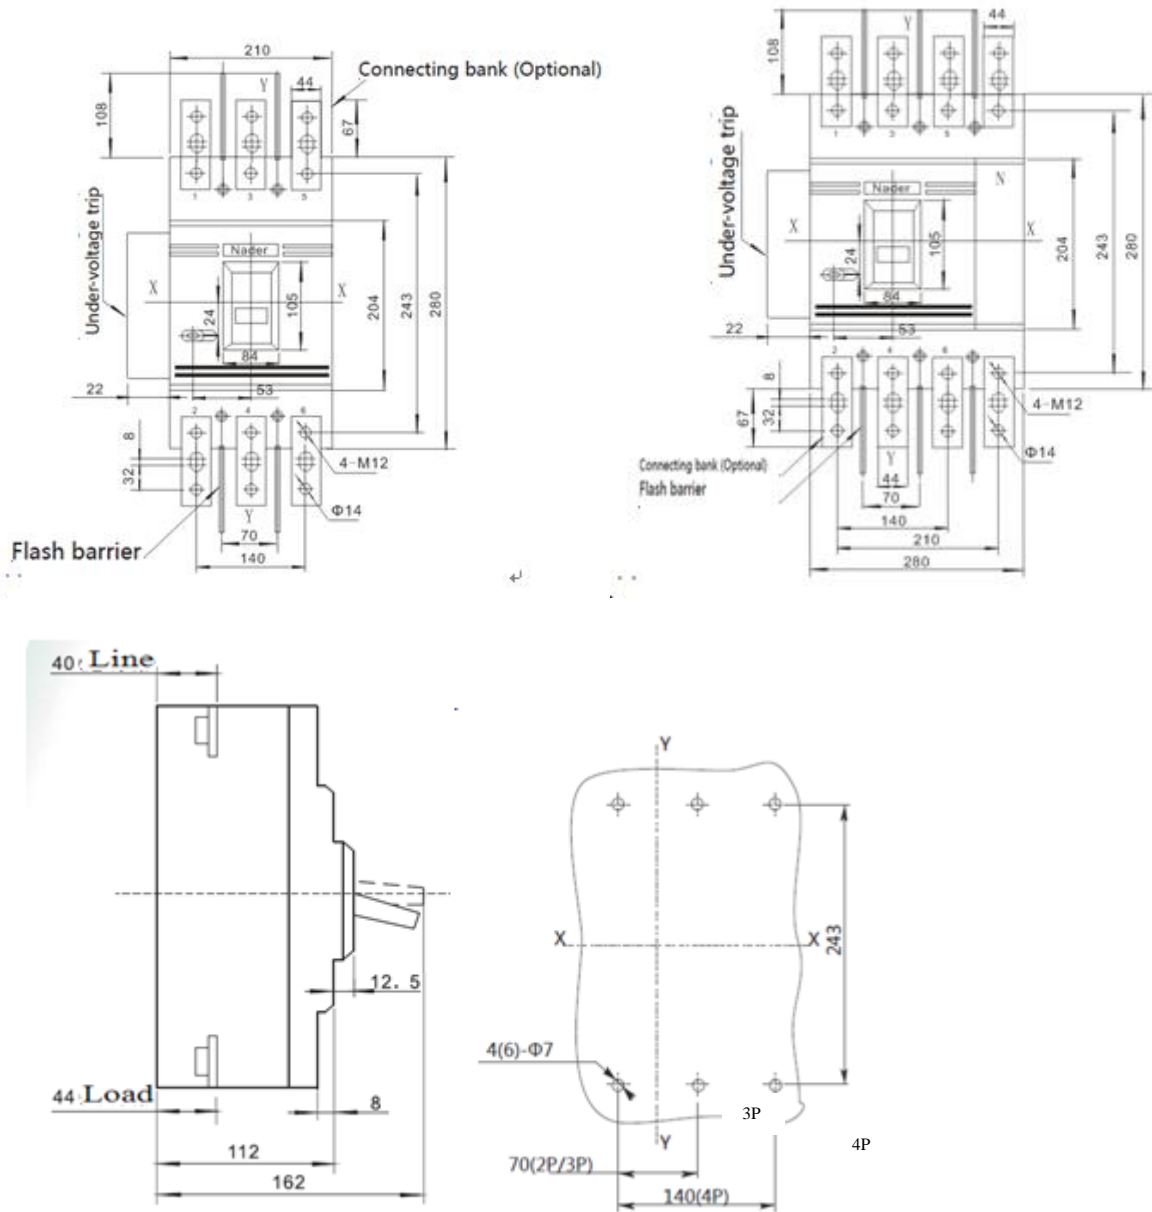


Note: The limit deviation not indicated with the tolerance dimensions is as per GB/T 1804-m.

Document No.	NDT500221	Version	1	Implementation date	20160630
--------------	-----------	---------	---	---------------------	----------

Mounting distance (mm)


1) Insulation distance mounted in the metal cabinet (unit: mm), as shown below:

Mounting distance	A (inlet wire end to the cabinet face)		B (distance from side to cabinet)	C (outlet wire end to the cabinet face)
	With a 0 arcing cover	Without a 0 arcing cover		
Specification				
NDM2-800	25	120	35	35



2) Minimum center distance between rowed circuit breakers:


Specification	Width of circuit breaker (mm)		Center distance (mm)	
	3P	4P	3P	4P
NDM2-800	210	280	250	320

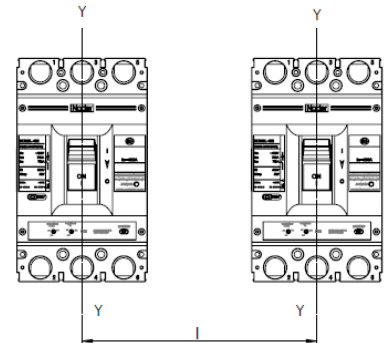

Note: Check the connected busbar or cable during rowing or stacking ensure that the air insulation distance won't be reduced.

3) Minimum center distance between stacked circuit breakers

Specification	H (distance of circuit breaker from bottom)	
	With a 0 arcing cover	Without a 0 arcing cover
NDM2-800	155	155

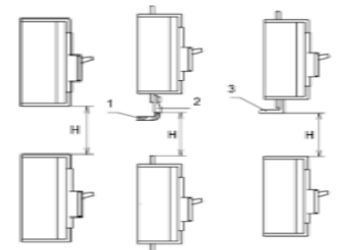

Note: 1. Bare cable connection

2. Cable insulating connection

3. Connection without insulation

4. Check whether the 0 arcing cover or phase partition is assembled properly before products are energized.

Document No.	NDT500221	Version	1	Implementation date	20160630
--------------	-----------	---------	---	---------------------	----------

8. Installation Mode

Installation mode: To be installed horizontally or vertically.

9. Packaging and Storage

Minimum packaging quantity: 1 piece/box. The packaged products should be stored in a warehouse with the ambient temperature of $-40^{\circ}\text{C}\sim 75^{\circ}\text{C}$ and the corresponding relative humidity below 80% without acidic, alkali or other corrosive gas in the surrounding air. Under the conditions above, the storage period shall be no more than 36 months since the manufacturing date.

10. List of Accessories and Installation

SN	Name	Specification	Quantity/Set
1	Cross small pan-head screws	M6X95	4 (3P)/6 (4P)
2.	Plain washer	6	8(3P)/12 (4P)
3	Spring washer	6	4 (3P)/6 (4P)
4	Hexagon nut	M6	4 (3P)/6 (4P)
5	Phase partition	—	4 (3P)/6 (4P)
6	Plug	—	6 (3P)/8 (4P)

11. Precautions

▲ Various characteristics and accessories of the circuit breaker are set in the factory, which shall not be adjusted randomly;

▲ The circuit breaker handle can be located in three positions, indicating three states: on, off and free tripping. When the handle is in the free tripping position, pull the handle in the off direction when the circuit breaker is connected and on.