

Product Specification

Product name: Molded Case Circuit Breaker (MCCB)

Product Model: NDM3A-250 Series

Date: 20170524

Prepared by	Reviewed by	Approved by
Yin Hongyu	Zhang Ying	Cai Yuchang

Nader 良信电器	Document Name	Product Specification	Document No.	NDT2930285
	Product Model and Name	NDM3A-250 Series Molded Case Circuit Breaker	Version	0
			Implementation Date	20170524

Revision History

Version	Revision Description	Revision Date	Revised by
0	New addition	20170411	Yin Hongyu
	The ambient temperature changes to $-40^{\circ}\text{C}\sim+70^{\circ}\text{C}$ from $-35^{\circ}\text{C}\sim+70^{\circ}\text{C}$	20170712	Yin Hongyu
	Applications of the molded case circuit breaker changes to be the new energy industry, power system, plant, etc	201700807	Yin Hongyu

Document No.	NDT2930285	Version	0	Implementation Date	20170524
--------------	------------	---------	---	---------------------	----------

1. Applicable Scope and Purpose


NDM3A series of molded case products apply to infrequent switching of circuits with the AC 50Hz (or 60Hz), the rated working voltage of 1000V and rated working current of 630A. With the overload, short circuit and undervoltage protection functions, the circuit breaker can protect lines and power equipment from damage.

The molded case circuit breaker is widely used in new energy industry, plant, building, household and other occasions.

2. Picture of the Product (The picture is for reference only; the specific kind prevail)



3. Specification and Model Description

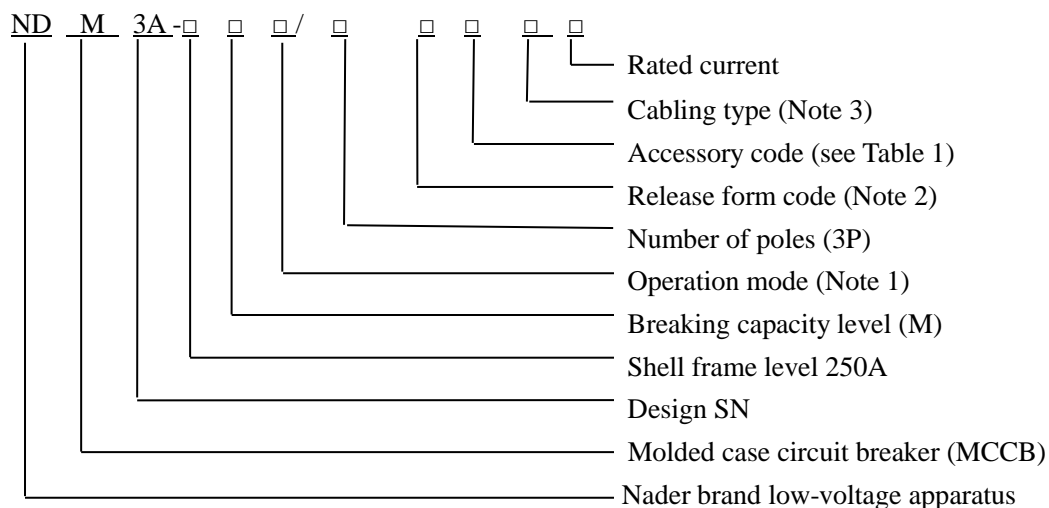

Document No.	NDT2930285	Version	0	Implementation Date	20170524
--------------	------------	---------	---	---------------------	----------

Note 1: Handle operation is uncoded; P: Representing the electric operation; Z: Representing the manual operation

Note 2: 0: Release (none); 2: Instantaneous release only; 3: Complex release

Note 3: ① Normal products are uncoded; ② P: Extended connection busbar; ③ Z1: Rear-plate connection; ④ Z2H: Plug-in rear-plate connection; ⑤ Z2Q: Plug-in front-plate connection

Table 1: Comparison Table of Accessory Code:

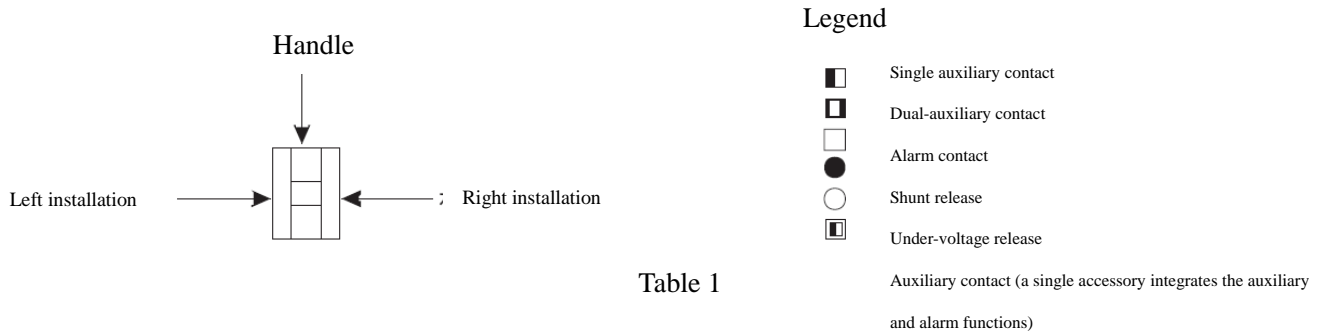


Table 1

Document No.	NDT2930285	Version	0	Implementation Date	20170524
--------------	------------	---------	---	---------------------	----------

Accessory code	Accessory name	Model		
		NDM3A-250	NDM3A-400	NDM3A-630
00	None	—	—	—
10	Shunt release			
20	Dual-auxiliary contact			
21	Single auxiliary contact			
30	Under-voltage release			
40	Shunt release, dual-auxiliary contact			
41	Shunt release, single auxiliary contact			
50	Shunt release, under-voltage release			
60	Two sets of dual auxiliary contacts			
61	Two sets of single auxiliary contacts			
62	Dual-auxiliary contact, single auxiliary contact			
70	Under-voltage release, dual-auxiliary contact			
71	Under-voltage release, single auxiliary contact			
08	Alarm contact			
18	Shunt release, alarm contact			
28	Dual-auxiliary contact, alarm contact			
38	Under-voltage release, alarm contact			
48	Shunt release, single auxiliary/alarm contact			
58	Single auxiliary/alarm contact			
68	Dual-auxiliary contact, single auxiliary/alarm contact			
78	Under-voltage release, single auxiliary/alarm contact			

4. Main Technical Parameters

Model	NDM3A-250M				
Rated current of frame I_{nm} (A)	250				
Rated current I_n (A)	63, 80, 100, 125, 140, 160, 180, 200, 225, 250				
Rated insulation voltage U_i (AC V)	1140				
Rated impulse withstand voltage U_{imp} (V)	8000				
Power frequency withstand voltage U (V)	3500				
Rated working voltage U_e (AC V)	550	600	690	800	1000
Rated limit short-circuit breaking capacity I_{cu} (kA)	50	42	35	30	12

Document No.	NDT2930285	Version	0	Implementation Date	20170524
--------------	------------	---------	---	---------------------	----------

Rated operating short-circuit breaking capacity I _{cs} (kA)		50	42	35	23	12
Operating performance (times)	Electrical life	5000	3000	2000	1500	1000
	Mechanical life	20000				
Boundary dimension		107×165×103				

5. Derating Parameter Table of Temperature for the Circuit Breaker

	Derating factor (I _n)						
	+40°C	+45°C	+50°C	+55°C	+60°C	+65°C	+70°C
NDM3A-250	1	0.982	0.963	0.944	0.924	0.904	0.882

Note: The above derating factors are measured at the frame current

6 High-altitude derating factor

Altitude (km)	Rated operating current	Maximum operating voltage	Rated power frequency withstand voltage
2	I _n	U _e	U
2.5	I _n	U _e	U
3	0.980I _n	0.870U _e	0.909U
3.5	0.972I _n	0.846U _e	0.858U
4	0.963I _n	0.813U _e	0.820U
4.5	0.951I _n	0.781U _e	0.784U
5	0.938I _n	0.743U _e	0.752U


7. Normal Working Environment

- ▲ Altitude: ≤2000m.
- ▲ Ambient temperature: -40°C~+70°C.(Reduced capacity is not considered with the temperature below +40°C)
- ▲ Pollution level: 3.
- ▲ The product can withstand the effects of wet air, salt mist, oil mist and mould.
- ▲ The product should be installed free from snow and rain.
- ▲ The product can be disposed in places that are free from explosive media, media corrosive to metal, insulation damaging gas, and conductive dust.
- ▲ In case of stricter user conditions than the above description, negotiate with the manufacturer.


8. Characteristic Curve of Circuit Breaker

Rated current of the release (A)	Thermal release (ambient temperature +40°C)		Action current of the magnetic release (A)	
	1.05I _n (cold state) inaction time (h)	1.3I _n (cold state) action time (h)	5I _n	10I _n (default)
63	≥ 1	< 1	5I _n (1±20%)	10I _n (1±20%)
63 < I _n ≤ 250	≥ 2	< 2	5I _n (1±20%)	10I _n (1±20%)

Document No.	NDT2930285	Version	0	Implementation Date	20170524
--------------	------------	---------	---	---------------------	----------


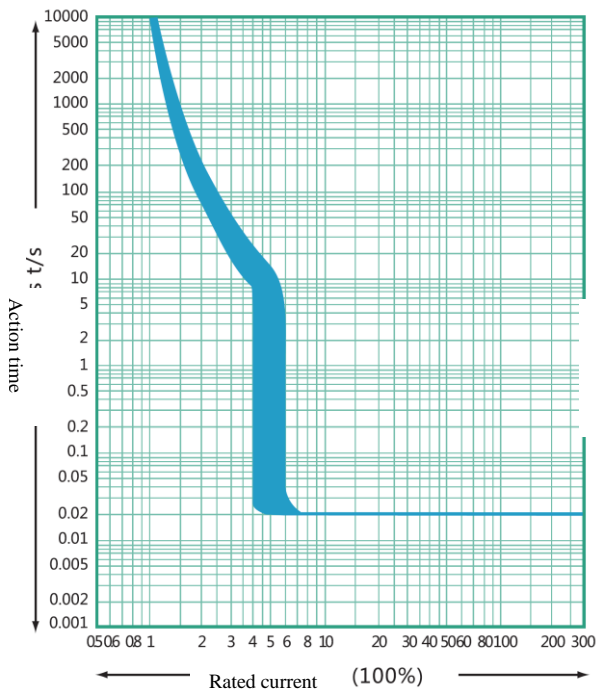


$I_i = 5 \times I_n$

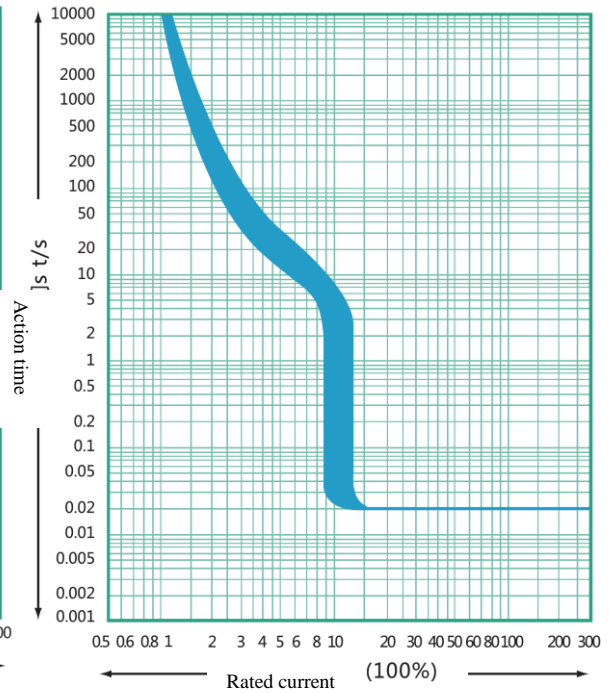


$I_i = 10 \times I_n$

9. Outline and Mounting Hole Dimensions

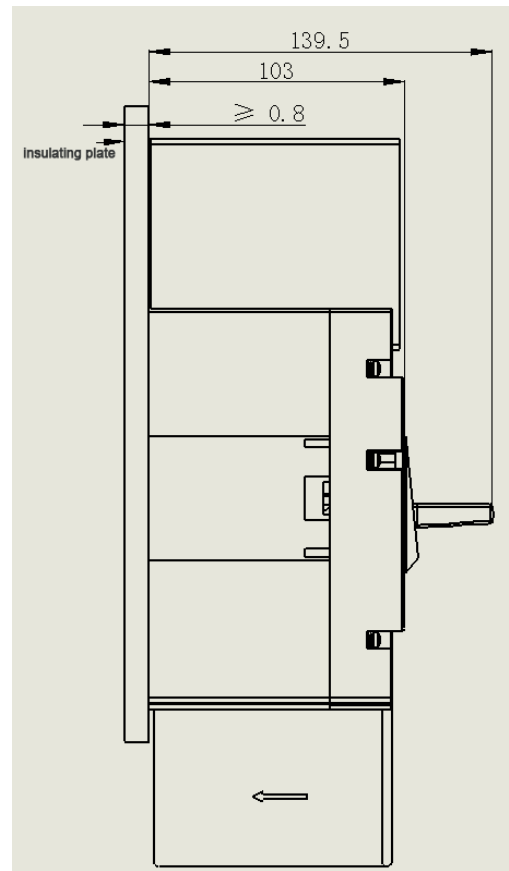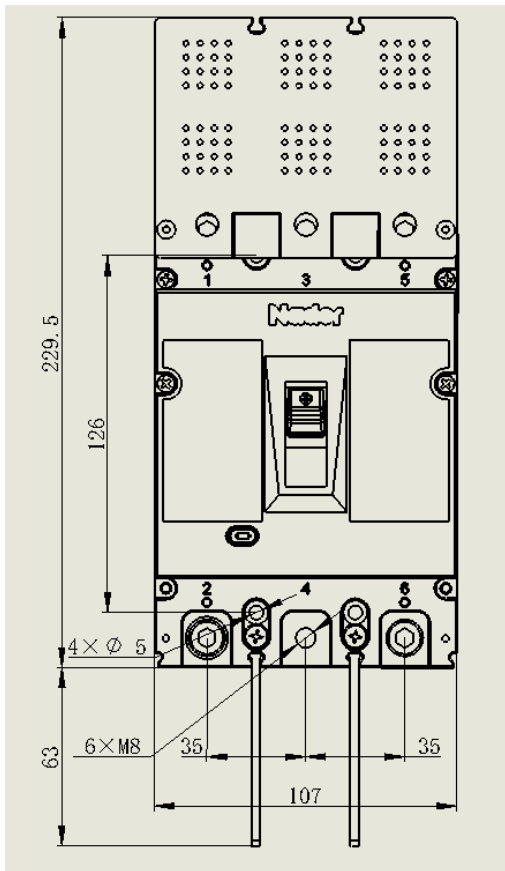

Document No.	NDT2930285	Version	0	Implementation Date	20170524
--------------	------------	---------	---	---------------------	----------

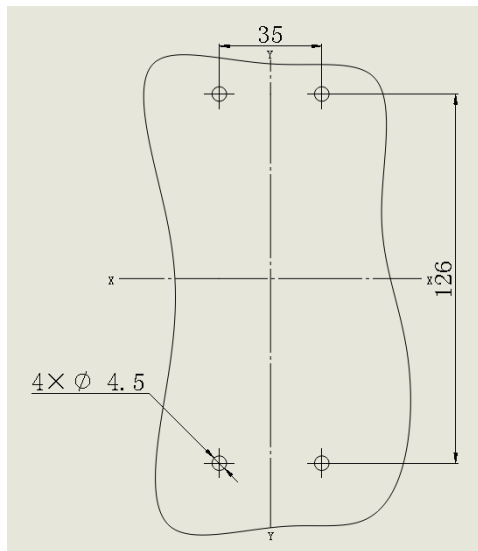


Note 1: The limit deviation not indicated with the tolerance dimensions is as per GB/T 1804-m.

2: During use, a terminal cover and phase partition shall be installed respectively on the terminal side of 1, 3, 5 as well as 2, 4, 6 as shown in the figure. Besides, an insulating plate shall be inserted between the circuit breaker and the metal mounting plate with the hole dimension of the insulating plate same as the mounting plate (to be prepared by users).

10. Installation Mode

Installation mode: The product can be installed horizontally or vertically. For vertical installation of the product, the gradient between the installation surface and the vertical plane is no more than $\pm 22.5^\circ$.

1) Insulation distance mounted in the metal cabinet (mm)

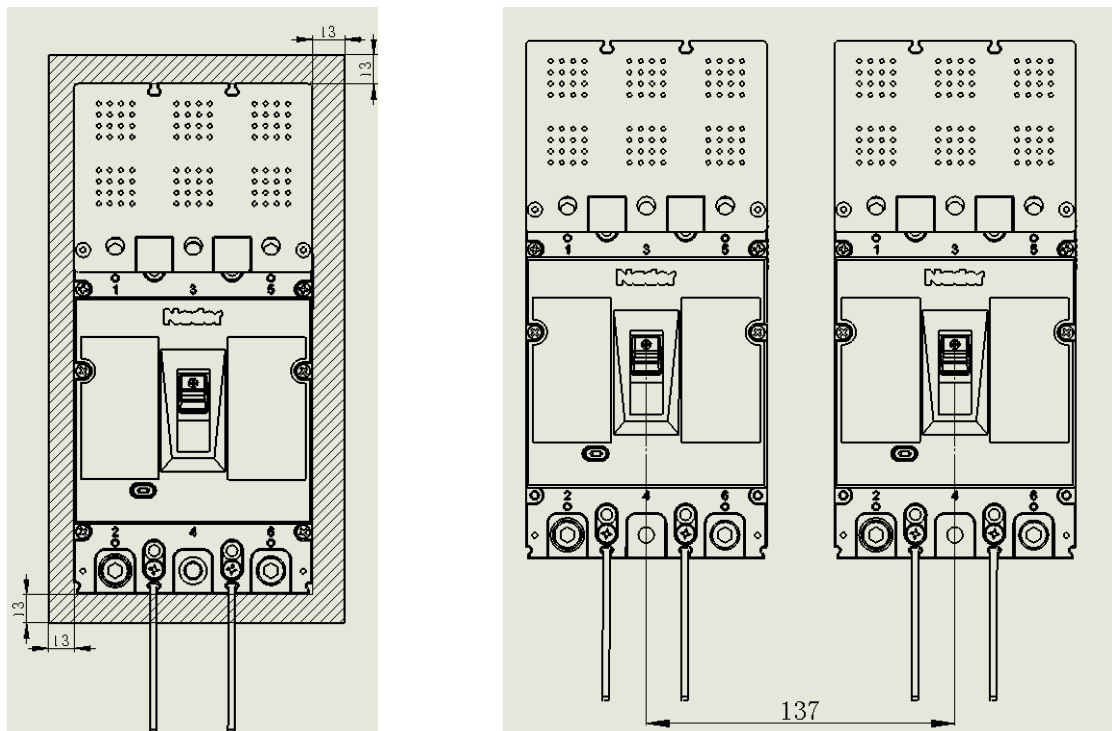

2) Minimum center distance between rowed circuit breakers (mm)

Note: Check the connected busbar or cable during rowing or stacking of the circuit breaker to ensure that the air insulation distance won't be reduced.

Document No.	NDT2930285	Version	0	Implementation Date	20170524
--------------	------------	---------	---	---------------------	----------

11. Packaging and Storage

Minimum packaging quantity: 1 piece/box. The packaged products should be stored in a warehouse with the ambient temperature condition of $-40^{\circ}\text{C}\sim 75^{\circ}\text{C}$ and the corresponding relative humidity below 80% to the temperature without acidic, alkali or other corrosive gas in the surrounding air. Under the conditions above, the storage period shall be no more than 36 months since the manufacturing date.

Document No.	NDT2930285	Version	0	Implementation Date	20170524
--------------	------------	---------	---	---------------------	----------

12. List of Accessories and Installation

SN	Name	Specification	Quantity/piece
1	Cross small pan-head combination screws	M4×45	4
2.	Hexagon nut	M4	4
3	Phase partition	—	2
4	Self-tapping screw	GB846-85ST2.9×9.5-C-H R	2

13. Precautions

▲ Various characteristics and accessories of the circuit breaker are set in the factory, which shall not be adjusted randomly;

▲ The circuit breaker handle can be located in three positions, indicating three states: on, off and free tripping. When the handle is in the free tripping position, pull the handle in the off direction when the circuit breaker is connected and on.

▲ Make sure to add a phase partition for product use.

▲ Tighten the accessory kit mounting screw M4 with a torque of 2.4Nm; when the terminal screw adopts the M8 hexagon screw, tighten it with a torque of 12Nm.